
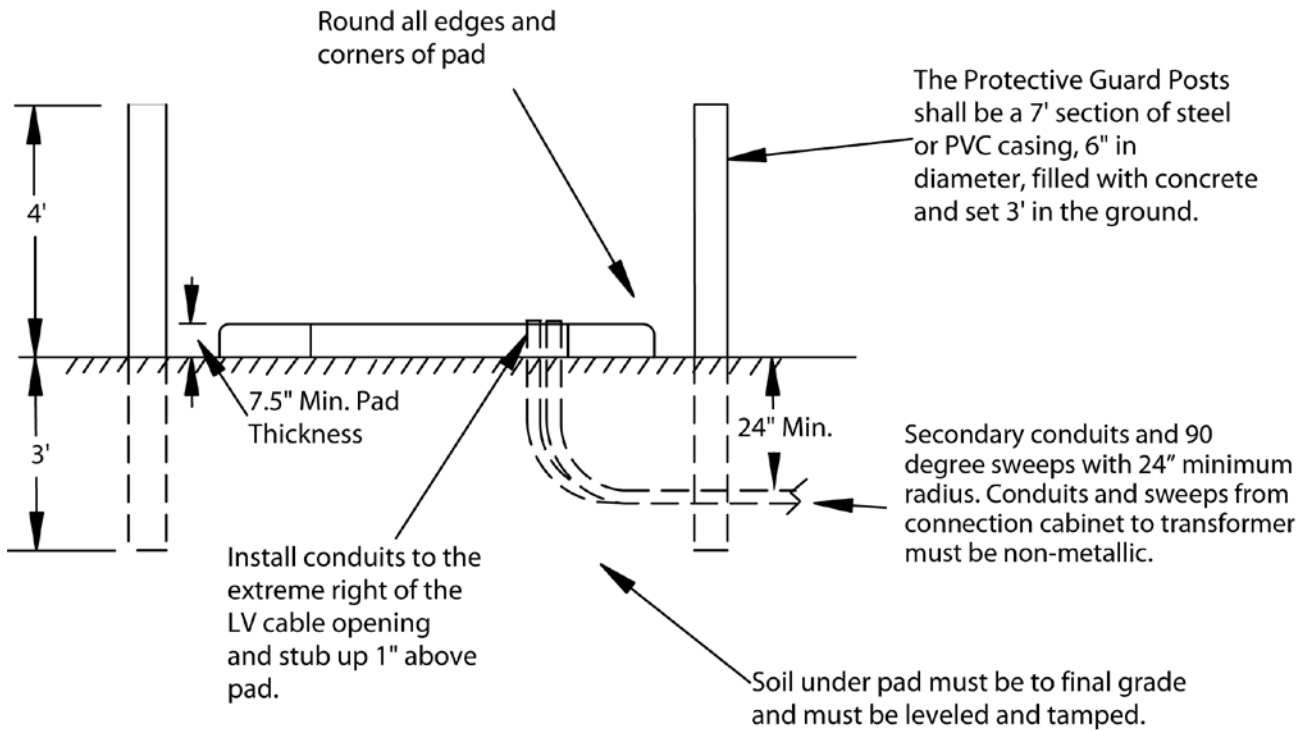


**FIGURE 2**  
**Transformer Concrete Pad and Protective Guard Post Specifications 45 to 1500 KVA 3PH Transformers**

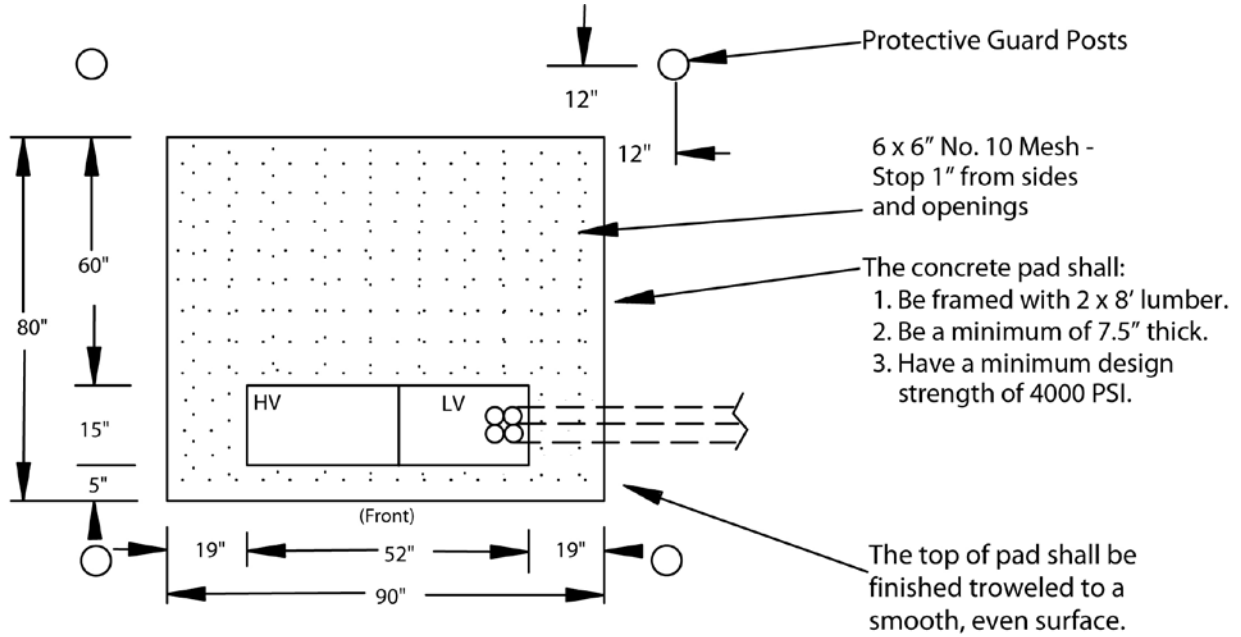

Note: 1. All secondary conduits shall be installed before pad is set or poured.  
 2. See "Three-Phase Underground Service With or Without Connection Cabinet" for cable and conduit installation details.