



## Typical Rural Street (End View)

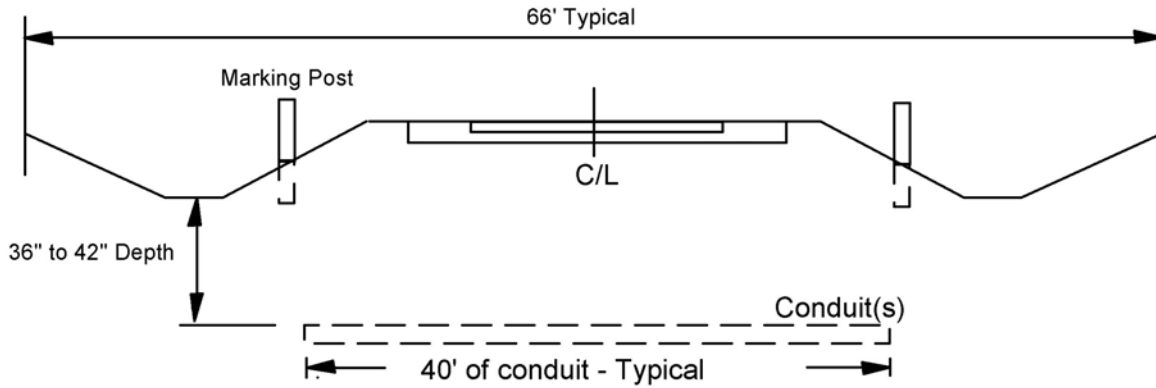

Note: 12" min. separation for multiple conduits

## Conduit Installation at Intersections

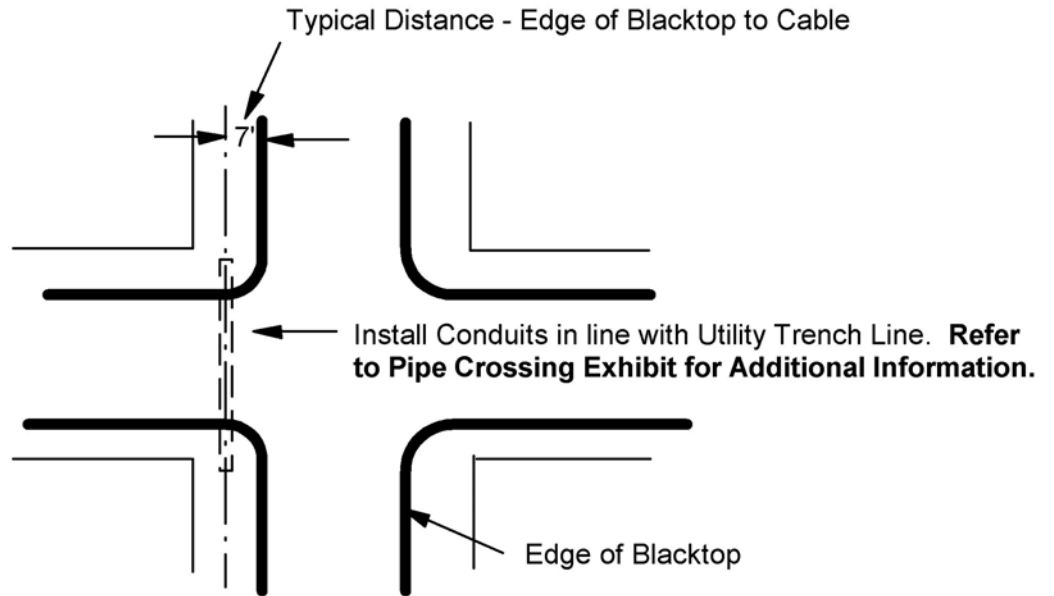

### Requirements:

1. Conduit(s) shall be 4" PVC unless otherwise noted.
2. Depth of conduit(s) shall be 36" to 42"
3. Mark ends of conduit.
4. If multiple conduits are needed, they shall be separated by 12".
5. At street intersections, install conduit(s) in line with the trench line described in the pipe crossing exhibits.

## CONDUIT INSTALLATION GUIDE RURAL STREETS

FEB 2006

**CONNEXUS  
ENERGY**

UX41